talentum®
Specialist flame detection


Datasheet

Talentum®
Flame Detector UV/IR2 Ex d
[EN] 16521-00

The Talentum® flameproof Ultra-Violet, dual Infra-Red (UV/IR2 Ex d) Flame Detector is designed to protect hazardous areas where open fires may be expected and detects almost all flames, including hydrocarbon fires with 4.3µm emissions through to invisible fires such as hydrogen.

The UV/IR2 Ex d Flame Detector is sensitive to flickering, low frequency (1-15Hz) infra-red radiation emitted by flames during combustion.

This detector has a UV sensor and two IR sensors which respond to different wavelengths of both the ultra-violet and the infra-red spectrum. The signals from these sensors are processed by the detector and checked for characteristics of a flame. The simultaneous detection of both the UV and the IR light by the sensors will signal an alarm. False alarms from flickering sunlight, arc welding and lightning are eliminated by a combination of UV and dual IR signal processing techniques. The Talentum® UV/IR2 Ex d detector has selectable output options of relay contacts or 4-20mA signal, as standard.

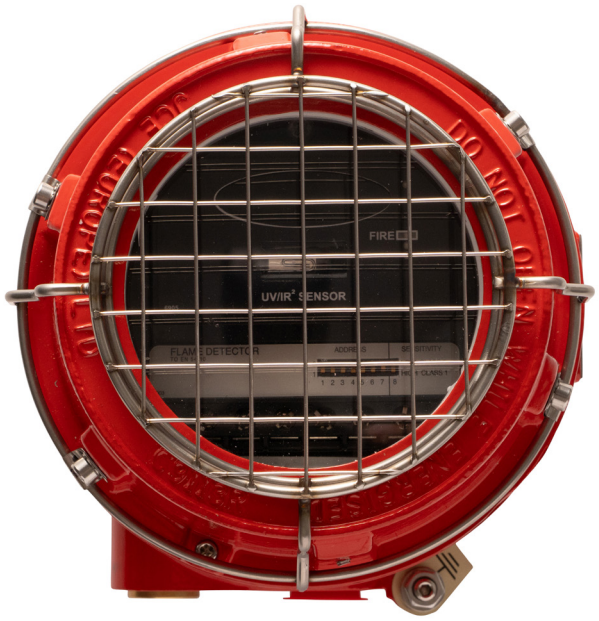

FEATURES
Highest immunity to false sources
Solar blind
Tolerant of fumes, vapours, dust and mist
Suitable for indoor and outdoor areas
Unaffected by convection currents, draughts or wind
Proven response to multiple fuel types
Multi-spectrum detection
Selectable output options
Selectable response speed
Selectable sensitivity levels
Built in auto and manual test
Low current consumption
Fast response to fire

APPLICATIONS	
Aircraft hangars	Nuclear power sites
Biomass storage & handling	Petrochemical offshore/ onshore
Chemical plants	Pharmaceutical production
Engine rooms	Printing
Fuel loading racks	Refineries
LNG/LPG production	Spray booths
Marine Industry	Storage tanks
Military appliations	

ACCESSORIES	
07127-00	Adjustable Mount Stainless Steel (316)
07279-00	Weather Shield Stainless Steel (316)
12555-00	Air Purge (Ex d)
1800-101	Talentum Test Torch

APPROVALS
Worldwide approvals include EN 54-10, VdS, LPCB and ATEX. Visit **ffeuk.com** for the up-to-date approval information.

SCAN THE QR CODE
TO EXPLORE THE TALENTUM
PRODUCT RANGE

Talentum®
Flame Detector UV/IR2 Ex d
[EN] 16521-00

Datasheet

MECHANICAL SPECIFICATION	
Housing material	Copper free aluminium alloy
Housing colour	Red
Dimensions	154(h) x 150(w) x 145(d) mm (6 1/16"(h) x 5 7/8"(w) x 5 11/16"(d))
Weight	2.3 kg (5 lb)
Cable gland entries	3 x M20
Wiring	1.0 to 4.0 mm² (12 – 18 AWG)

ELECTRICAL SPECIFICATION	
Supply voltage	14 to 30 Vdc
Quiescent current	8 mA, RL2 energised 4 mA, current loop, RL2 off 3 mA, RL2 off
Alarm current	28 mA, RL1 & RL2 energised 20 mA, current loop, RL1 & 2 off 9 mA, RL1 energised
Power-up time	2 seconds max.
Self test voltage	14 to 30 Vdc
Relay outputs Programmable	Normally Open or Normally Closed. Latching or Non-Latching
Relay maximum ratings	
Current	0.75 A
Voltage	48 Vdc
Power	30 W
(Note: resistive loads only)	
Refer to User Manual for further details	

ENVIRONMENTAL	
Operating temperature	EN: -10°C to +55°C (+14°F to +131°F)
Storage temperature	-20°C to +65°C (-4°F to +149°F)
Relative humidity	95% non condensing
IP rating	IP66


PERFORMANCE	
Range	
High (Class 1)*	0.1 m² n-heptane at 25 m (82 ft)
Low (Class 3)	0.1 m² n-heptane at 12 m (39¼ ft)
	(see EN 54-10 for sensitivity settings)
Field of view	90° min. Cone
Operating wavelength	
UV	185 to 260 nm
IR	1.0 to 2.7 µm
* Has been tested and approved at Class I	

RESPONSE CHARACTERISTICS – HIGH SENSITIVITY			
Fuel	Flame size m² (in²)	Distance m (ft)	Approval
n-Heptane* (Yellow flame)	0.1 (144)	25 (82)	EN 54-10
Methylated spirit* (Clear flame)	0.25 (400)	25 (82)	EN 54-10


Response time: typically 4 seconds
* Has been tested and approved at Class 1

FIELD OF VIEW

Horizontal

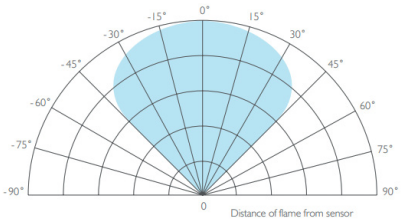



Vertical




To meet the requirements of EN 54-10:2002 clause 5.4 (Directional Dependence), viewing angles must not exceed ±20°.

DIMENSIONS



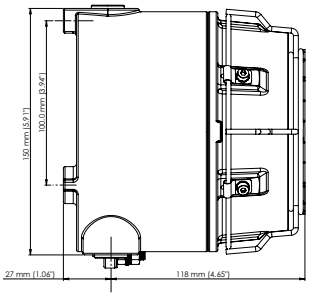

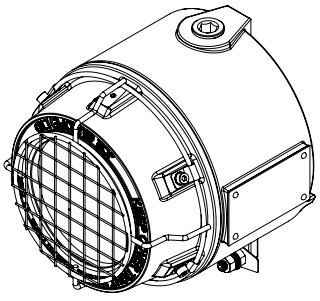

INSTALLATION RECOMMENDATIONS

Please refer to our User Manual for mounting and wiring instructions. The installation of Talentum® flame detectors should be undertaken in accordance with recognised national or international standards and codes of practice.

FFE Limited, 9 Hunting Gate, Hitchin, Hertfordshire SG4 0TJ, UK
t: +44 (0) 1462 444 740 **e:** sales@ffeuk.com **w:** ffeuk.com
FFE Limited, 1455 Jamike Ave Ste 200, Erlanger, KY 41018-3147, USA
t: +1 859 957 1570 **e:** america@ffeus.com **w:** ffeus.com

Specifications and wiring information are provided for information only and are believed to be accurate. FFE Ltd assumes no responsibility for their use. Data and design are subject to change without notice. Installation and wiring instructions are shipped with the products and should always be used for actual installation. For more information, contact your Sales Representative.

Document Part No: 24-0263-02