Cat6a S/FTP Purple LSZH Cable

PRODUCT OVERVIEW

Solid conductor 4 pair Cat6a S/FTP (Overall braided screen,each pair individually foil screened) cable with LSZH Purple outer sheath.

Each cable consists of 8 colour coded high density polyethylene insulated conductors. These are twisted together to form 4 pairs with varying lay lengths. These pairs, together with a strong nylon rip cord are jacketed in LSZH material.



ADIC6ASFTPLSZDP500

FEATURES

Cat 6a 4 pair LSZH solid cable with 8 colour coded high density polyethylene insulated conductors

23 AWG Bare copper conductors

500 metre reel

Purple RAL 4005

Reaction for Fire Rating - Dca s2, a1, d2 (CPR Rating)

Rip cord for ease of stripping outer sheath

Manufactured and tested to ISO/IEC 11801, ANSI/TIA 568-C.2 standards.

Sequential reverse metre markings (305-0)

S/FTP overall screening and foil screen per pair

Supports Gigabit Ethernet

10 Year Warranty

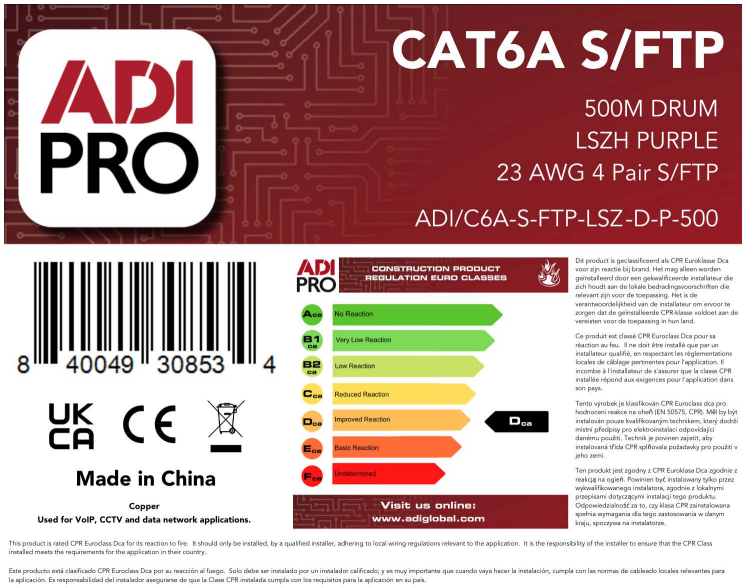

For more information contact your ADI sales person or visit us at www.adiglobal.com

Rev: Oct 23

UK CA CE RoHS COMPLIANT

Cat6a S/FTP Purple LSZH Cable

CROSS-SECTION DIAGRAM



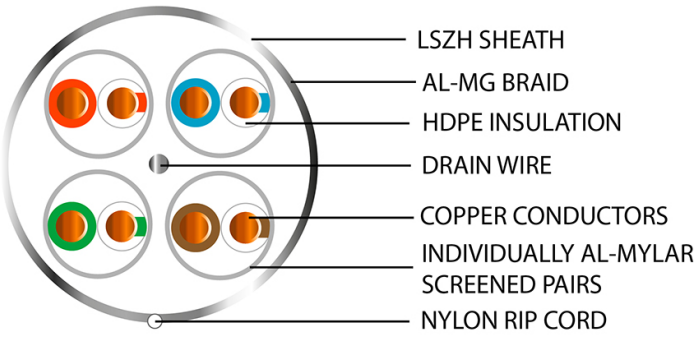

PRODUCT SPECIFICATIONS

Conductor: Bare Copper
Conductor Size: AWG 23
Overall Cable Diameter (mm): 6.80
Impedance (1-100Mhz): 100Ω ±15Ω
Insulation: HDPE
Insulation Diameter (mm): 1.30 ± 0.05
Insulation Colour(s): Blue/White/Blue; Orange/White/Orange; Green/White/Green ;Brown/White/Brown
Nylon Rip-Cord: White 210D
Jacket: LSZH
Jacket Thickness (mm): 0.55
Rated Temperature: -40 - +70°C
Overall Screening: Braiding
Conductor Screening: Foil

ADIC6ASFTPLSZDP500

Rev: Oct 23

For more information contact your ADI sales person or visit us at www.adiglobal.com

Cat6a S/FTP Purple LSZH Cable

CONSTRUCTION PRODUCT REGULATIONS (CPR)

EURO CLASS (ca:cable)	CLASSIFICATION CRITERIA: FIRE RATING	CPR Description
Reaction to Fire BS EN ISO 1716		
A_{ca}	Does not contribute to the fire	Due to availability, it will be almost impossible for a cable to meet Aca, so they should only be specified with extreme caution.
Reaction to Fire BS EN 50399		
$B1_{ca}$	Minimum contribution to the fire	It's highly unlikely the commonly-used cables will be classified to Class B1ca.
$B2_{ca}$	Combustible, low flame spread & heat release contribution to the fire	Similar to Class Cca, although a lower acceptable heat release rate and burn measurement. In practice, this is likely to be the highest class cables will meet.
C_{ca}	Combustible, moderate flame spread & heat release	This is a more rigorous test than Class Dca, this is widely accepted across Europe as the 'go to' classification, but be aware, many cables do not meet Class Cca though availability is improving.
D_{ca}	Combustible, moderate flame spread & heat release	This classification has relatively little use or acceptance within specifying/contracting organisations. This is because no large scale fire growth is measured.
Reaction to Fire BS EN 60332-1-2		
E_{ca}	Combustible, limited fire spread of less than 425mm	A basic test for vertical flame propagation for a single insulated wire or cable using a 1 KW pre-mixed flame. Note: This test does not measure heat release, toxic fumes or smoke.
F_{ca}	Combustible, fire spread of more than 425mm	Cables classified to Class Fca may have high levels of flammability due to the materials they are made of. This does not mean that the cable cannot be used, it is more likely to be used external.

CPR GUIDE

SUBCLASSIFICATIONS FOR EUROCLASSES Bca to Dca

(S) SMOKE PRODUCTION	(D) FLAMING DROPLETS	(A) SMOKE ACIDITY
BS EN 50399/BS EN 61034-2	BS EN 50399	BS EN 60754-2
s1a: s1 + transmittance >=80% (BS EN 61034-2)	d0: No fall of droplets or flaming particles, times for 1200 seconds	a1: Very low acidity (conductivity <2.5 µS/mm & pH >4.3)
s1b: s1 + transmittance >=60% <80% (BS EN 61034-2)	d1: Fall of droplets or flaming particles that persist for less than 10 seconds, timed for 1200 seconds	a2: low acidity (conductivity <10 µS/mm & pH >4.3)
s1: Low production of slow propagation of smoke		
s2: Intermediate production & propagation of smoke		
s3: None of the above	d2: None of the above	d2: None of the above

Visit us online:
www.adiglobal.com

Classes A to E have to be tested by an independent authorised laboratory. Most cables will fall into classes B2ca to Eca.

For a cable to meet Aca, B1ca, B2ca or Cca, there also needs to be regular on-going factory audits.

This product is rated CPR Euroclass Dca s2, a1, d2 for its reaction to fire

This product should only be installed, by a qualified installer, adhering to local wiring regulations relevant to the application. It is the responsibility of the installer to ensure that the CPR Class installed meets the requirements for the application in their country.



Visit us online:
www.adiglobal.com

ADIC6ASFTPLSZDP500

For more information contact your ADI sales person or visit us at www.adiglobal.com

Rev: Oct 23